



INSTALLATION DATA MANUAL  
MODELS 548/748/848  
PRESSURE TRANSMITTERS

38 Forge Parkway  
Franklin, MA 02038  
Int'l: 1-716-629-3800  
Toll Free: 1-800-688-0030  
Fax: 1-716-693-9162  
[www.viatran.com](http://www.viatran.com)  
[solutions@viatran.com](mailto:solutions@viatran.com)

## COMPANY BACKGROUND

Viatran is an ISO 9001:2000 certified company committed to providing high quality pressure transducers and transmitters. Established more than 40 years ago, Viatran has built its reputation on providing durable, and accurate pressure sensing devices. Our products are often specifically requested by integrators and engineering firms for applications ranging from the offshore oil rigs to pump control to tank and well level measurement. Viatran is often called for custom modifications for applications where standard products are not available.

## TECHNICAL SUPPORT

Technical assistance is available Monday-Friday 8:00 AM to 5:00 PM (Eastern) from our knowledgeable factory personnel to answer any of your application or installation questions. Our toll free number is 1-800-688-0030. Questions or additional documentation can also be requested via e-mail at [solutions@viatran.com](mailto:solutions@viatran.com).

## CUSTOMER SERVICE

Orders for additional units or accessories can be placed by calling customer service at 1-800-688-0030 or by fax at 716-693-9162. Orders can also be placed by contacting a local representative in your area. To find the nearest representative visit our web site at [www.viatran.com](http://www.viatran.com) and click on rep search.

## PRODUCT OVERVIEW

**MANUAL SCOPE:** Information contained in this document is representative of a standard Model 548/748/848. If the product has special requirements or modifications, refer to the permanently marked information on the product and your purchase order for possible alteration to the product's configuration. Failure to verify product configuration before installation may cause permanent product damage and in most cases, void the manufacturer's product warranty. If you are unsure or have questions about your product, please contact your Application Engineer (1-800-688-0030) for assistance.

Remove and retain all enclosed instruction manuals and performance certificates. These documents provide important information on the product's calibration, operation, safety precautions, recommended maintenance, re-calibration requirements, repair service instructions and warranty information. These documents are updated from time to time as changes to the product occur and should be reviewed at receipt so that proper and safe installation can occur.

**PRODUCT DESCRIPTION AND GENERAL USE:** Viatran's model X48 uses a piezoresistive sensing chip mounted behind an isolated diaphragm constructed of stainless steel. The 48 series is designed to measure process pressures in applications compatible with stainless steel. The 548, 748 and 848 have standard outputs of 4-20 mA, 0-5 V dc or mV/V respectively. The standard electrical connection are 6' pigtail leads potted in a 1/2" NPT male conduit connection which can be easily connected inside a conduit connection box. Model 548, 748 and 848 are approved for use in hazardous locations by FM, CSA and ATEX for explosion proof, non-incendive and intrinsically safe. Viatran provides many standard options including alternate pressure port fittings and connectors to custom fit your unit. The 548 and 748 also offers an improved linearity option to improve the accuracy of the unit to better than 0.1% FSO best fit straight line.

## BASIC OPERATION


The model X48 is pre-set at the factory for the required output and is referenced to atmospheric pressure (zero PSIG), with the exception of absolute units. The reference for an absolute unit is absolute zero (full vacuum). Once factory set, the product should perform as indicated by the performance certificate and product labeling. Any deviation from the factory settings could indicate damage to the sensor, electronics or both. If your product is equipped with zero and span adjustments the unit can be recalibrated if a calibrated pressure source is available, or by using the shunt cal if your unit is equipped with this option. All units are sent with a calibration card that contains the unique calibration for your Viatran unit. Please retain this sheet; should the zero or span reading vary greatly from the calibration card it may indicate damage to the sensor or some form of obstruction in the breather filter, if equipped.

## HANDLING REQUIREMENTS AND CAUTIONS

1. All electrical & pressure connections should be compatible with the model specifications as outlined above.
2. The product's internal electrical circuitry is DC isolated from case ground. It is recommended that the case ground wire be connected to earth ground at the cable termination, as this is an integral part of the internal surge protection and noise immunity features.
3. On some lower range models a breather opening, with breather filter, is used to allow for proper product function. At no time should the filter be removed in service. If any mist, vapor or fluid is permitted to enter this breather without the filter, unit failure may occur.
4. At no time should an object be pressed against the sensing area to deflect the sensor (to test or simulate pressure), as on some models permanent damage to the sensing diaphragm may occur.
5. When shipped in quantities, units should be packaged individually to eliminate possible damage.

## INSTALLATION DATA - VIATRAN MODEL 548/748/848

Note: The drawing below is for informational purposes only and is not to scale.  
All dimensions are nominal, in inches and for reference purposes only.

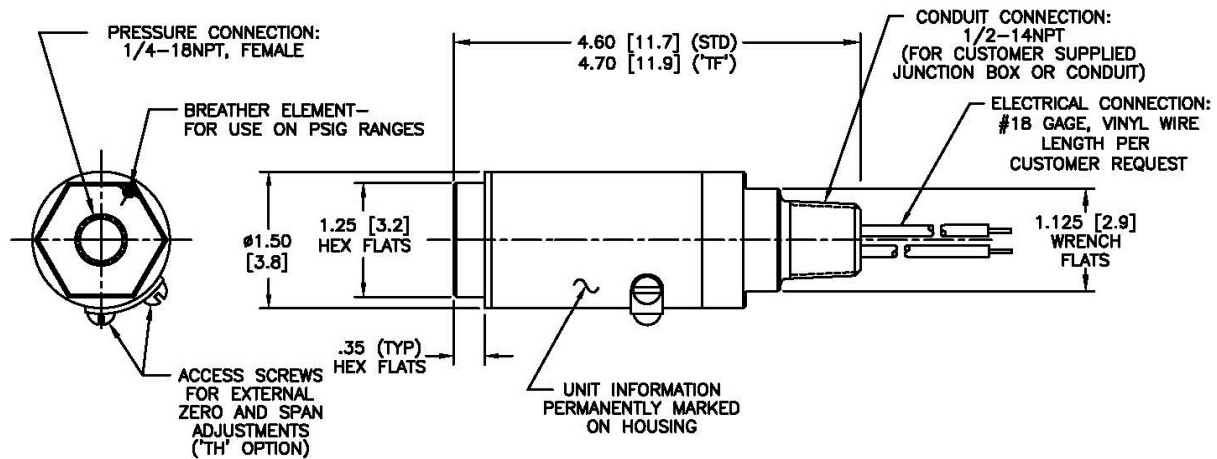

**MODEL 548**  
**Input:**  
9 - 30 VDC  
9 - 28 VDC approved units  
**Output:**  
4 - 20 mA

**MODEL 748**  
**Input:**  
9 - 30 VDC  
9 - 28 VDC approved units  
**Output:**  
0 - 5 VDC

**MODEL 848**  
**Input:**  
10 V nominal, 15 V Maximum  
**Output:**  
5 - 10 mV/V

### Sensor Construction and Wetted materials

0 - 3 thru 0 - 5000 PSI: Oil Filled - Silicon - 316 Stainless Steel


### Pressure Connection

1/4" NPT female


## CONNECTION DIAGRAMS & WIRING

Electrical Mating Connection:


Acceptable 18AWG wire termination connection - 1/2" NPT (M)

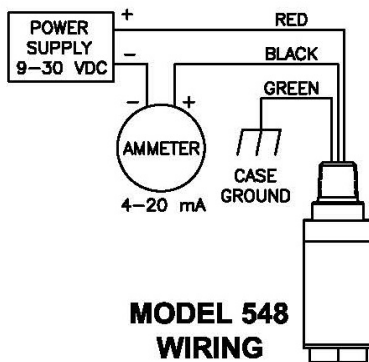

Red: + Power / + Signal  
Black: - Power / - Signal  
Green: Case Ground

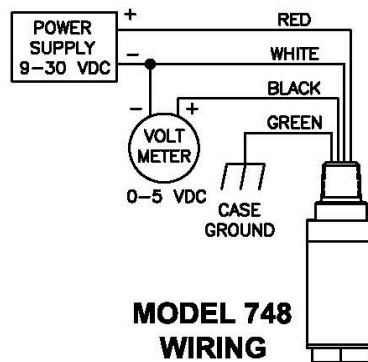

Red: + Power  
White: - Signal / - Power  
Black: + Signal  
Green: Case Ground

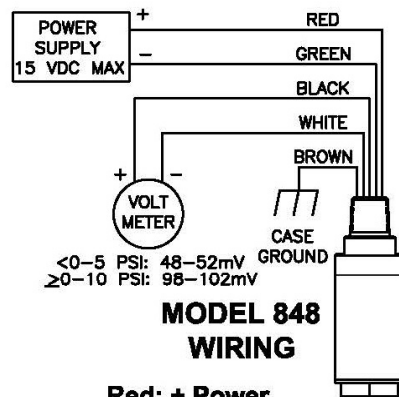


Red: + Power  
Green: - Power  
Black: + Signal  
White: - Signal  
Brown: Case Ground

*Note: If the unit is certified for hazardous locations as Intrinsically Safe, use the enclosed connection diagram. Only the pressure transmitter is considered to have the Factory Mutual, CSA or ATEX safety ratings. If you have purchased a transmitter and isolator/remote seal, they have not been tested as a system for safety certification. The end-user shall be responsible for verifying the system is safe and installed accordingly.*


# OPTIONAL APPROVALS MODEL 548



PRESAFE 16 ATEX 8250X




APPROVED  
NONINCENDIVE FOR USE IN  
CL I, II & III, DIV. 2,  
GFS A,B,C,D,E,F,G  
CL I, ZN 2, GP IIC  
T4, Ta=80°C, TS, Ta=40°C  
NEMA/TYPE 4X, HAZ LOC  
DUAL SEAL  
for Process Temps -40°F to 300°F




APPROVED  
NONINCENDIVE FOR USE IN  
CL I, DIV. 2, GFS A,B,C,D  
CL I, ZN 2, GP IIC  
T4, Ta=80°C, TS, Ta=40°C HAZ LOC  
DUAL SEAL  
for Process Temps -40°F to 300°F




APPROVED  
NONINCENDIVE FOR USE IN  
CL I, II & III, DIV. 2,  
GFS A,B,C,D,E,F,G  
CL I, ZN 2, GP IIC  
T4, Ta=80°C, TS, Ta=40°C  
NEMA/TYPE 4X, HAZ LOC




CSA 04 1507558  
CLASS I, DIV. 2,  
GRPS A,B,C,D;  
CLASS II, DIV. 2,  
GRPS F,G;  
CLASS III, DIV. 2  
TS at Ta=80°C  
Type 4 Encl.  
Dual Seal




CSA 04 1507558  
CLASS I, DIV. 2,  
GRPS A,B,C,D;  
TS at Ta=80°C



CLASS I, DIV. 1,  
GRPS A,B,C,D;  
CLASS II, DIV. 1, GRPS E,F,G;  
CLASS III, DIV. 1  
Ex Ia IIC T4, Ta=80°C,  
TS, Ta=40°C  
Type 4 Encl.  
per drawing CD0646.  
Dual Seal



CLASS I, DIV. 1,  
GRPS A,B,C,D;  
Ex Ia IIC T4, Ta=80°C,  
TS, Ta=40°C  
per drawing CD0646.



APPROVED  
INT. SAFE FOR USE IN  
CL I/II, DIV. 1, GFS A,B,C,D,E,F,G  
CL I, ZN 0, AEx Ia IIC T4, Ta=80°C,  
TS, Ta=40°C NEMA/TYPE 4X, HAZ. LOC.  
INSTALL PER CD0647  
DUAL SEAL  
for Process Temps -40°F to 300°F




APPROVED  
INT. SAFE FOR USE IN  
CL I, DIV. 1, GFS A,B,C,D,  
CL I, ZN 0, AEx Ia IIC T4, Ta=80°C,  
TS, Ta=40°C HAZ. LOC.  
INSTALL PER CD0647  
DUAL SEAL  
for Process Temps -40°F to 300°F



APPROVED  
INT. SAFE FOR USE IN  
CL I/II, DIV. 1, GFS A,B,C,D,E,F,G  
CL I, ZN 0, AEx Ia IIC T4, Ta=80°C,  
TS, Ta=40°C NEMA/TYPE 4X, HAZ. LOC.  
INSTALL PER CD0647



APPROVED  
INT. SAFE FOR USE IN  
CL I, DIV. 1, GFS A,B,C,D,  
CL I, ZN 0, AEx Ia IIC T4, Ta=80°C,  
TS, Ta=40°C HAZ. LOC.  
INSTALL PER CD0647




APPROVED  
EXPLOSION PROOF FOR USE  
IN CL I, DIV 1, GFS A,B,C,D  
CL I/II, DIV 1, GFS E,F,G  
CL I, ZN 1, AEx d IIC  
TS at Ta=80°C NEMA 4X  
HAZ. LOC.  
Factory Sealed,  
Conduit Seal not Required  
DUAL SEAL  
for Process Temps -40°F to 300°F




APPROVED  
EXPLOSION PROOF FOR USE  
IN CL I, DIV 1, GFS A,B,C,D  
CL I/II, DIV 1, GFS E,F,G  
TS at Ta=80°C NEMA 4X  
HAZ. LOC.  
Factory Sealed,  
Conduit Seal not Required  
DUAL SEAL  
for Process Temps -40°F to 300°F




APPROVED  
EXPLOSION PROOF FOR USE  
IN CL I, DIV 1, GFS A,B,C,D  
CL I/II, DIV 1, GFS E,F,G  
CL I, ZN 1, AEx d IIC  
TS at Ta=80°C NEMA 4X  
HAZ. LOC.  
Factory Sealed,  
Conduit Seal not Required




PRESAFE 16 ATEX 8249X



PRESAFE 16 ATEX 8249X



PRESAFE 16 ATEX 8249X



PRESAFE 16 ATEX 8249X



# OPTIONAL APPROVALS MODEL 748

748\_TF\_(A)

[All product except as noted in labels 748TF(B-D)]



APPROVED  
INTRINSICALLY SAFE FOR USE IN  
CLASS I, II, III, DIV. 1, GROUPS A,B,C,D,E,F,G  
CLASS I, ZONE 0, AEx ia IIC T4, Ta=80°C,  
T5, Ta=40°C NEMA/TYP 4X, HAZ. LOC.  
INSTALL PER CD0650  
DUAL SEAL  
for Process Temps -40°F to 300°F

748\_TF\_(B)

[G, V formats, TB, ZU]



APPROVED  
INTRINSICALLY SAFE FOR USE IN  
CLASS I, DIV. 1, GROUPS A,B,C,D,  
CLASS I, ZONE 0, AEx ia IIC T4, Ta=80°C,  
T5, Ta=40°C HAZARDOUS LOCATIONS  
INSTALL PER CD0650  
DUAL SEAL  
for Process Temps -40°F to 300°F

748\_TF\_(C)

[All product ≤299 PSIA/S/V]



APPROVED  
INTRINSICALLY SAFE FOR USE IN  
CLASS I, II, III, DIV. 1, GROUPS A,B,C,D,E,F,G  
CLASS I, ZONE 0, AEx ia IIC T4, Ta=80°C,  
T5, Ta=40°C NEMA/TYP 4X, HAZ. LOC.  
INSTALL PER CD0650

748\_TF\_(D)

[TH, All alternate electrical connections except ZU]



APPROVED  
INTRINSICALLY SAFE FOR USE IN  
CLASS I, DIV. 1, GROUPS A,B,C,D,  
CLASS I, ZONE 0, AEx ia IIC T4, Ta=80°C,  
T5, Ta=40°C HAZARDOUS LOCATIONS  
INSTALL PER CD0650

748\_NZ\_(A)

[All product except as noted in labels 748NZ(B-C)]



APPROVED  
NONINCENDIVE FOR USE IN  
CL I, II & III, DIV 2,  
GPS A,B,C,D,F,G  
CL I, ZN 2, GP IIC  
T4, Ta=80°C, T5, Ta=40°C  
NEMA/TYP 4X, HAZ. LOC.  
DUAL SEAL  
for Process Temps -40°F to 300°F

748\_NZ\_(B)

[G' Gage format, TH, TB, ZU]



APPROVED  
NONINCENDIVE FOR USE IN  
CL I, DIV 2, GPS A,B,C,D  
CL I, ZN 2, GP IIC  
T4, Ta=80°C, T5, Ta=40°C HAZ. LOC.  
DUAL SEAL  
for Process Temps -40°F to 300°F

748\_NZ\_(C)

[All product ≤299 PSIA/S/V]



APPROVED  
NONINCENDIVE FOR USE IN  
CL I, II & III, DIV 2,  
GPS A,B,C,D,F,G  
CL I, ZN 2, GP IIC  
T4, Ta=80°C, T5, Ta=40°C  
NEMA/TYP 4X, HAZ. LOC.

748\_NZ\_(D)

[All Alt. Connectors]



APPROVED  
NONINCENDIVE FOR USE IN  
CL I, DIV 2, GPS A,B,C,D,  
T4, Ta=80°C, T5, Ta=40°C  
HAZ. LOC.  
WARNING: DO NOT DISCONNECT THE  
CONNECTOR WHILE THE CIRCUIT IS  
LIVE WHEN A FLAMMABLE OR  
COMBUSTIBLE ATMOSPHERE IS PRESENT.

748\_TK\_



Ex nA IIC T4 Gc  
(-20°C<Ta<80°C)  
PRESAFE 16 ATEX 8251X



748\_NY\_(A)

[All product ≥300 PSIS/A]



APPROVED  
EXPLOSION PROOF FOR USE  
IN CL I, DIV 1, GPS A,B,C,D  
CL II/III, DIV 1, GPS E,F,G  
CL I, ZN 1, AEx d IIC  
T5 at Ta=88°C NEMA 4X  
HAZ. LOC.  
Factory Sealed,  
Conduit Seal not Required  
DUAL SEAL  
for Process Temps -40°F to 300°F

748\_NY\_(B)

[All product (All Ranges)  
PSIG/PSIV/TB Option]



APPROVED  
EXPLOSION PROOF FOR USE  
IN CL I, DIV 1, GPS A,B,C,D  
CL II/III, DIV 1, GPS E,F,G  
T5 at Ta=88°C NEMA 4X  
HAZ. LOC.  
Factory Sealed,  
Conduit Seal not Required  
DUAL SEAL  
for Process Temps -40°F to 300°F

748\_NY\_(C)

[All product <300 PSIS/A]



APPROVED  
EXPLOSION PROOF FOR USE  
IN CL I, DIV 1, GPS A,B,C,D  
CL II/III, DIV 1, GPS E,F,G  
CL I, ZN 1, AEx d IIC  
T5 at Ta=88°C NEMA 4X  
HAZ. LOC.  
Factory Sealed,  
Conduit Seal not Required

748\_NG\_



Ex db IIC T8...T4 Gb  
T8...T4: -20°C<Ta<60°C  
PRESAFE 16 ATEX 8250X  
CE 2460

748\_FA\_



METROLOGY CERT:  
OC.C.30C001.A No 73774

748\_NK\_



Ex ia IIC T4 Gc  
(-20°C<Ta<80°C)  
Ui=28V, Ii=100mA  
Li=1.8μH, Ci=9nF  
Pi≤1W

PRESAFE 16 ATEX 8249X



748\_DE\_NK\_



Ex ia IIC T4 Gc  
(-20°C<Ta<80°C)  
Ui=28V, Ii=100mA  
Li=2.4μH, Ci=12nF  
Pi≤1W

PRESAFE 16 ATEX 8249X



748\_NK\_ZU\_



Ex ia IIC T4 Gc  
(-20°C<Ta<80°C)  
Ui=28V, Ii=100mA  
Li=69μH, Ci=20nF  
Pi≤1W

PRESAFE 16 ATEX 8249X



748\_DE\_NK\_ZU\_



Ex ia IIC T4 Gc  
(-20°C<Ta<80°C)  
Ui=28V, Ii=100mA  
Li=70μH, Ci=23nF  
Pi≤1W

PRESAFE 16 ATEX 8249X



[TJ & NX Maximum Pressure 5,000 PSI]

748\_NX\_(A)

[All product except as noted in label 748\_NX\_(B)]



CSA 04 1507558  
CLASS I, DIV 1,  
GRPS A,B,C,D;  
CLASS II, DIV 1, GRPS E,F,G;  
CLASS III, DIV 1,  
Ex ia IIC T4, Ta=80°C,  
T5, Ta=40°C  
Type 4 Encl.  
per drawing CD0649.  
Dual Seal

748\_NX\_(B)

[G, V formats, TH, or any alt. electrical connections]



CSA 04 1507558  
CLASS I, DIV. 1,  
GRPS A,B,C,D;  
Ex ia IIC T4, Ta=80°C,  
T5, Ta=40°C  
per drawing CD0649.

748\_TJ\_(A)

[All product except as noted in 748\_TJ\_(B)]



CSA 04 1507558  
CLASS I, DIV. 2,  
GRPS A,B,C,D;  
CLASS II, DIV. 2,  
GRPS F,G;  
CLASS III, DIV. 2  
T5 at Ta=80°C  
Type 4 Encl.  
Dual Seal



748\_TJ\_(B)

[G & alt. connectors]




CSA 04 1507558  
CLASS I, DIV. 2,  
GRPS A,B,C,D;  
T5 at Ta=80°C







# OPTIONAL APPROVALS MODEL 848

848\_NG  
 II 2 G  
Ex db IIC T6...T4 Gb  
T6...T4: -20°C<Ta<80°C  
PRESAFE 16 ATEX 8250X




848\_NX\_  
 II 1 G  
Ex ia IIC T4 Ga  
(-20°C<Ta<80°C)  
Ui=28V, Ii=100mA  
Li=2.4μH, Ci=12nF  
Pi≤1W  
PRESAFE 16 ATEX 8249X



848\_NK\_ZU\_  
 II 1 G  
Ex ia IIC T4 Ga  
(-20°C<Ta<80°C)  
Ui=28V, Ii=100mA  
Li=70μH, Ci=23nF  
Pi≤1W  
PRESAFE 16 ATEX 8249X



848\_TK\_  
 II 3 G  
Ex nA IIC T4 Gc  
(-20°C<Ta<80°C)  
PRESAFE 16 ATEX 8251X



[TJ & NX Maximum Pressure 5,000 PSI]

848\_NX\_(A)  
[All product except as  
noted in label 848\_NX\_(B)]



CSA 04 1507558  
CLASS I, DIV. 1,  
GRPS A,B,C,D;  
CLASS II, DIV. 1, GRPS E,F,G;  
CLASS III, DIV. 1,  
Ex ia IIC T4, Ta=80°C,  
T5, Ta=40°C  
Type 4 Encl.  
per drawing CD0646.  
Dual Seal

[G, V formats, TH, or any  
alt. electrical connections]



CSA 04 1507558  
CLASS I, DIV. 1,  
GRPS A,B,C,D;  
Ex ia IIC T4, Ta=80°C,  
T5, Ta=40°C  
per drawing CD0646.

[All product except as  
noted in 848\_TJ\_(B)]



CSA 1507558  
CLASS I, DIV. 2,  
GRPS A,B,C,D;  
CLASS II, DIV. 2,  
GRPS F,G;  
CLASS III, DIV. 2  
T5 at Ta=80°C  
Type 4 Encl.  
Dual Seal

848\_TJ\_(B)  
[G, V formats or alt.  
electrical connectors]



CSA 1507558  
CLASS I, DIV. 2,  
GRPS A,B,C,D;  
T5 at Ta=80°C

848\_NY\_(A)  
[All product ≥300 PSIS/A]



APPROVED  
EXPLOSION PROOF FOR USE  
IN CLASS I, DIV. 1, GROUPS A,B,C,D  
CLASS II/III, DIV. 1, GROUPS E,F,G  
CLASS I, ZONE 1, AEx d IIC  
T5 at Ta=88°C NEMA 4X  
HAZARDOUS LOCATIONS  
Factory Sealed,  
Conduit Seal not Required  
DUAL SEAL  
for Process Temps -40°F to 300°F

848\_NY\_(B)  
[All product (All Ranges)  
PSIG/PSIV/TB Option]



APPROVED  
EXPLOSION PROOF FOR USE  
IN CLASS I, DIV. 1, GROUPS A,B,C,D  
CLASS II/III, DIV. 1, GROUPS E,F,G  
T5 at Ta=88°C NEMA 4X  
HAZARDOUS LOCATIONS  
Factory Sealed,  
Conduit Seal not Required  
DUAL SEAL  
for Process Temps -40°F to 300°F

848\_NY\_(C)  
[All product <300 PSIS/A]



APPROVED  
EXPLOSION PROOF FOR USE  
IN CLASS I, DIV. 1, GROUPS A,B,C,D  
CLASS II/III, DIV. 1, GROUPS E,F,G  
CLASS I, ZONE 1, AEx d IIC  
T5 at Ta=88°C NEMA 4X  
HAZARDOUS LOCATIONS  
Factory Sealed,  
Conduit Seal not Required

848\_NZ\_(A)  
[All product except as  
noted in labels 848NZ(B-C)]



APPROVED  
NONINCENDIVE FOR USE IN  
CL I, II & III, DIV. 2,  
GPS A,B,C,D,F,G  
CL I, ZN 2, GP IIC  
T4, Ta=80°C, T5, Ta=40°C  
NEMA/TYPE 4X, HAZ LOC  
DUAL SEAL  
for Process Temps -40°F to 300°F

848\_NZ\_(B)  
[G' Gage format, TH, TB, ZU]




APPROVED  
NONINCENDIVE FOR USE IN  
CL I, DIV. 2, GPS A,B,C,D  
CL I, ZN 2, GP IIC  
T4, Ta=80°C, T5, Ta=40°C HAZ LOC  
DUAL SEAL  
for Process Temps -40°F to 300°F

848\_NZ\_(C)  
[All product ≤299 PSIA/S/V]



APPROVED  
NONINCENDIVE FOR USE IN  
CL I, II & III, DIV. 2,  
GPS A,B,C,D,F,G  
CL I, ZN 2, GP IIC  
T4, Ta=80°C, T5, Ta=40°C  
NEMA/TYPE 4X, HAZ LOC

848\_FA\_  


METROLOGY CERT:  
OC.C.30C001.A No 73774

848\_TF\_(A)  
[All product except as  
noted in labels 848TF(B-D)]



APPROVED  
INTRINSICALLY SAFE FOR USE IN  
CL I,II,III, DIV. 1, GPS A,B,C,D,E,F,G  
CL I, ZN 0, AEx ia IIC T4, Ta=80°C,  
T5, Ta=40°C NEMA/TYPE 4X, HAZ. LOC.  
INSTALL PER CD0647  
DUAL SEAL  
for Process Temps -40°F to 300°F

848\_TF\_(B)  
[G, V formats, TB, ZU]



APPROVED  
INTRINSICALLY SAFE FOR USE IN  
CL I, DIV. 1, GPS A,B,C,D,  
CL I, ZN 0, AEx ia IIC T4, Ta=80°C,  
T5, Ta=40°C HAZ. LOC.  
INSTALL PER CD0647  
DUAL SEAL  
for Process Temps -40°F to 300°F

848\_TF\_(C)  
[All product ≤299 PSIA/S/V]



APPROVED  
INTRINSICALLY SAFE FOR USE IN  
CL I,II,III, DIV. 1, GPS A,B,C,D,E,F,G  
CL I, ZN 0, AEx ia IIC T4, Ta=80°C,  
T5, Ta=40°C NEMA/TYPE 4X, HAZ. LOC.  
INSTALL PER CD0647

848\_TF\_(D)  
[TH, All alternate  
electrical connections  
except ZU]



APPROVED  
INTRINSICALLY SAFE FOR USE IN  
CL I, DIV. 1, GPS A,B,C,D,  
CL I, ZN 0, AEx ia IIC T4, Ta=80°C,  
T5, Ta=40°C HAZ. LOC.  
INSTALL PER CD0647

## SPECIAL CONDITIONS FOR USE


Certificate	Type	Special Instruction
Presafe 16 ATEX 8250X	ATEX Flameproof	The pressure transmitters are constructed with permanently connected unterminated conductors and unprotected bushing. The external part of the bushing and the conductors terminated outside the flameproof enclosure shall be protected with one of the types of protection listed in EN 60079-0.
Presafe 16 ATEX 8251X	ATEX Non Incendive	<ol style="list-style-type: none"> <li>1. The external part of the bushing and the conductors terminated outside the enclosure shall be protected with one of the types of protection listed in EN 60079-0 and provide a minimum ingress protection rating of IP54.</li> <li>2. For ambient above 70°C, wiring with an appropriate temperature rating shall be used.</li> </ol>
1000784 (LR 34272)	CSA Explosion Proof	Transmitter must be powered by an approved SELV source, in accordance with CSA standard C22.2 No.1010.1, Annex H
Presafe 16 ATEX 8249X	ATEX IS	<ol style="list-style-type: none"> <li>1. The flying leads must be protected by an enclosure of at least IP 20 when mounted.</li> <li>2. Thread size and type: ½" NPT</li> </ol>

## MECHANICAL INSTALLATION

The X48 series requires no special mounting equipment. The unit may be mounted directly to the process fitting in any orientation with negligible positioning error. For standard NPT pressure fittings it is recommended that Teflon tape or an equivalent sealant be applied to the threads before installation. It is recommended that all NPT fittings be torque to 50 ft/lbs.

## ELECTRICAL CONNECTIONS

The standard wiring of your Viatran pressure transmitter is outlined on page 3. If your unit was ordered with an alternate connector or special wiring refer to the wiring marking permanently marked on your unit. The X48 series transmitters can be powered by a dc power supply ranging from 9 to 30 volts. If you have a 4-20 mA (548) device please refer to the load/voltage chart (below) to identify the required input voltage for your specific system load. The recommended load impedance for the model 748 is 50k ohms minimum.

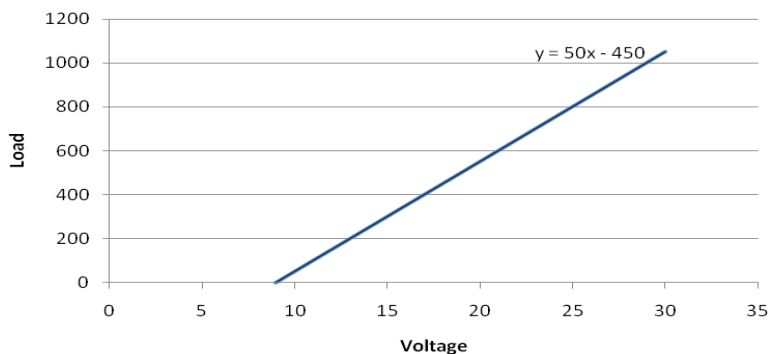

## **MAINTENANCE AND REPAIR**

All Viatran transmitters have been designed to function free from routine or scheduled maintenance. Simple cleaning of the pressure cavity on an as needed basis will provide many years of satisfactory performance. Protecting the product from continued exposure to moisture or fluids at the electrical connection, breather area will eliminate premature internal failure of the product. Generally any time the product is removed from service, the pressure cavity should be flushed with a stainless steel compatible cleaner to prevent media buildup. During the cleaning process only a soft, lint-free cloth is recommended. Never use a coarse or stiff bristle brush to clean media from the diaphragm surface.

It is suggested that the calibration be verified on a usage dependent schedule. If the product is in continuous service 7 days a week, then calibration verification may be necessary every 6 to 8 months. If the product is in a lab test environment, a more lenient verification schedule would be appropriate. In all instances the performance of the product will depend on the individual application or process in which it is installed. More continued usage would require a shorter period between calibration verification and product maintenance.

If a product is perceived to be exhibiting problems, it can be returned to Viatran for analysis and/or repair. It is suggested that only Viatran personnel attempt repair of the product. Any damage resulting from customer disassembly would result in a loss of coverage under the warranty policy. Older products returned for repair are updated to current specifications unless the repair cost would outweigh the cost of a new replacement model. Products returned for repair should include information on the person to contact for repair quote approval, the individual to contact if Viatran's technical staff requires additional information during analysis, and a brief description of the problem associated with the product's failure.

## **REPAIR INSTRUCTIONS**

Viatran's Transmitters are designed to be easily repaired and recalibrated if necessary. If a failure occurs, the transmitter should be returned to the factory for inspection and testing. Please contact the Customer Support Department at 1-800-688-0030, for a return tracking number and/or a repair cost estimate. A nominal inspection fee is charged on all units returned to the factory which are not subsequently repaired.

## **WARRANTY**

Viatran Corporation warrants that its products shall be free from defective workmanship and/or material for a period of twelve (12) months from the date of shipment, provided that Viatran's obligation hereunder shall be limited to correcting any defective workmanship and/or replacing any defective material f.o.b. factory. No allowance will be made for any expense incurred for correcting any defective workmanship and/or material without written consent by Viatran. This warranty is in lieu of all other warranties expressed or implied.

199 Fire Tower Drive  
Franklin, MA 02038  
Toll Free: 1-800-688-0030  
International: 716-629-3800  
Fax: 716-693-9162  
[www.viatran.com](http://www.viatran.com)  
[solutions@viatran.com](mailto:solutions@viatran.com)